


ELECTRICAL ONE LINE

NOTES:

1. ALL METER ENCLOSURES SHALL BE CLEARLY LABELED WITH AN APPROVED NAMEPLATE MADE OF A PERMANENT MATERIAL. A NAMEPLATE SHALL BE ON BOTH INSIDE THE METER ENCLOSURE AND THE FACEPLATE
2. AN APPROVED DISCONNECT SHALL BE INSTALLED ON THE UTILITY SIDE OF THE GENERATION. THE DISCONNECT SHALL BE OUTSIDE, LOCKABLE, AND WITHIN CLOSE PROXIMITY TO THE METER.
3. THE DISCONNECT SHALL BE CLEARLY MARKED WITH THE NAMEPLATE MADE OF A PERMANENT MATERIAL
4. INVERTERS SHALL BE IEEE 1547 AND UL 1741 SB COMPLIANT AND MUST DISCONNECT FROM THE GRID DURING POWER OUTAGES.

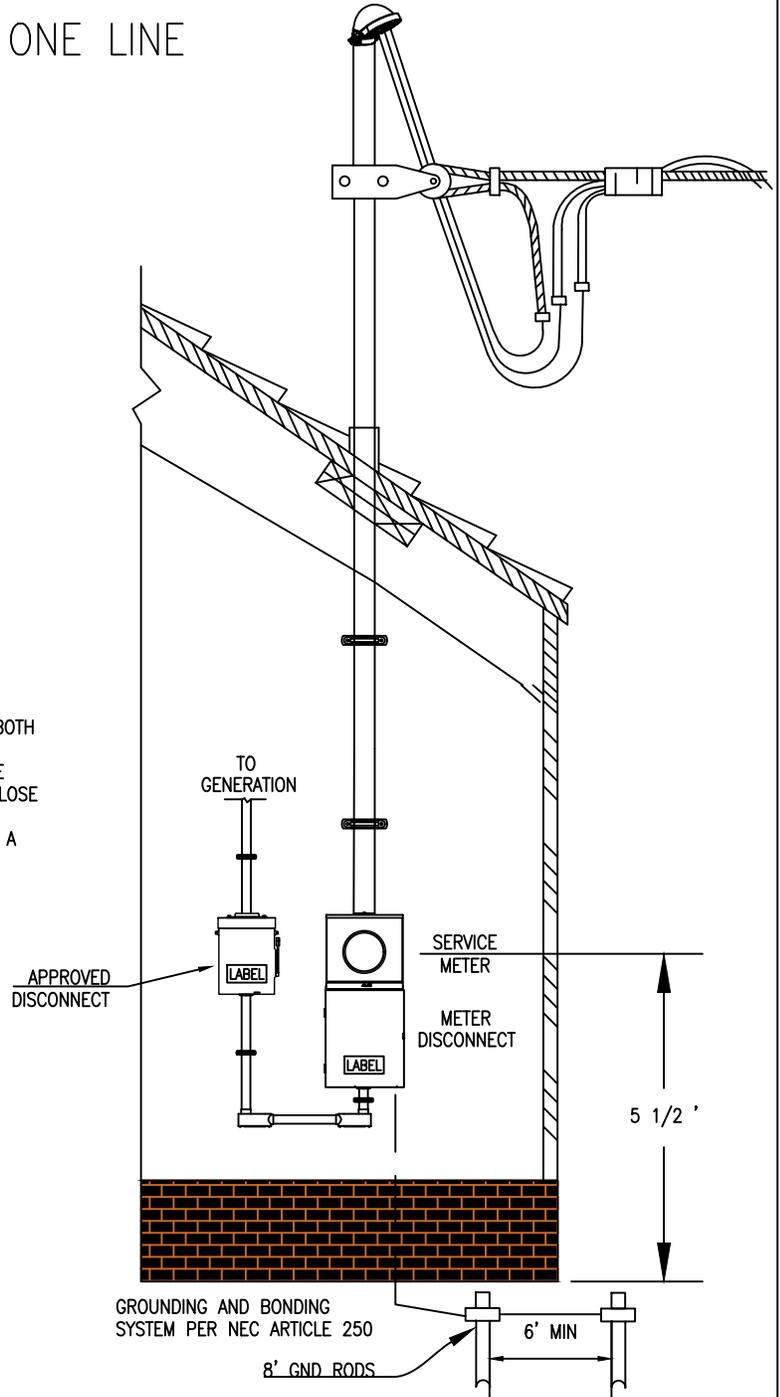

 <b>Eastern Maine Electric Cooperative</b> A Touchstone Energy Cooperative <i>The power of human connections</i>	Serving the Eastern Border of the United States	EASTERN MAINE ELECTRIC COOPERATIVE	
		CALAIS, ME	
		EMEC NET METERING SPECIFICATIONS	
		DES: EMEC    DRN: ASB CKD: ASB    SCALE: NONE DATE: 1/1/25	DWG. NO. NET-MTR
			REV <span style="border: 1px solid black; padding: 2px;">2</span>